


(8) LEADS, #16, .062 THICK INSUL. TO EXTEND BEYOND MOTOR:  
 BLK=26.000+2-0, RED=26.000+2-0  
 BRN=26.000+2-0, ORG=26.000+2-0  
 BLU=26.000+2-0, PUR=20.000+2-0  
 YEL=26.000+2-0, PUR=20.000+2-0

NOTE:  
 POSITION OF BEARING CAP RELATIVE TO ENDSHIELD (VIEWING LEAD END)  
 LEAD END - SLIT ON BONDED OUTER RING SHOULD BE NEAREST TO 3:00. OPPOSITE LEAD END - SHOULD BE NEAREST TO 9:00.

SUPPLIED DETACHED:  
 1-20 MFD/370V OIL FILLED CAPACITOR

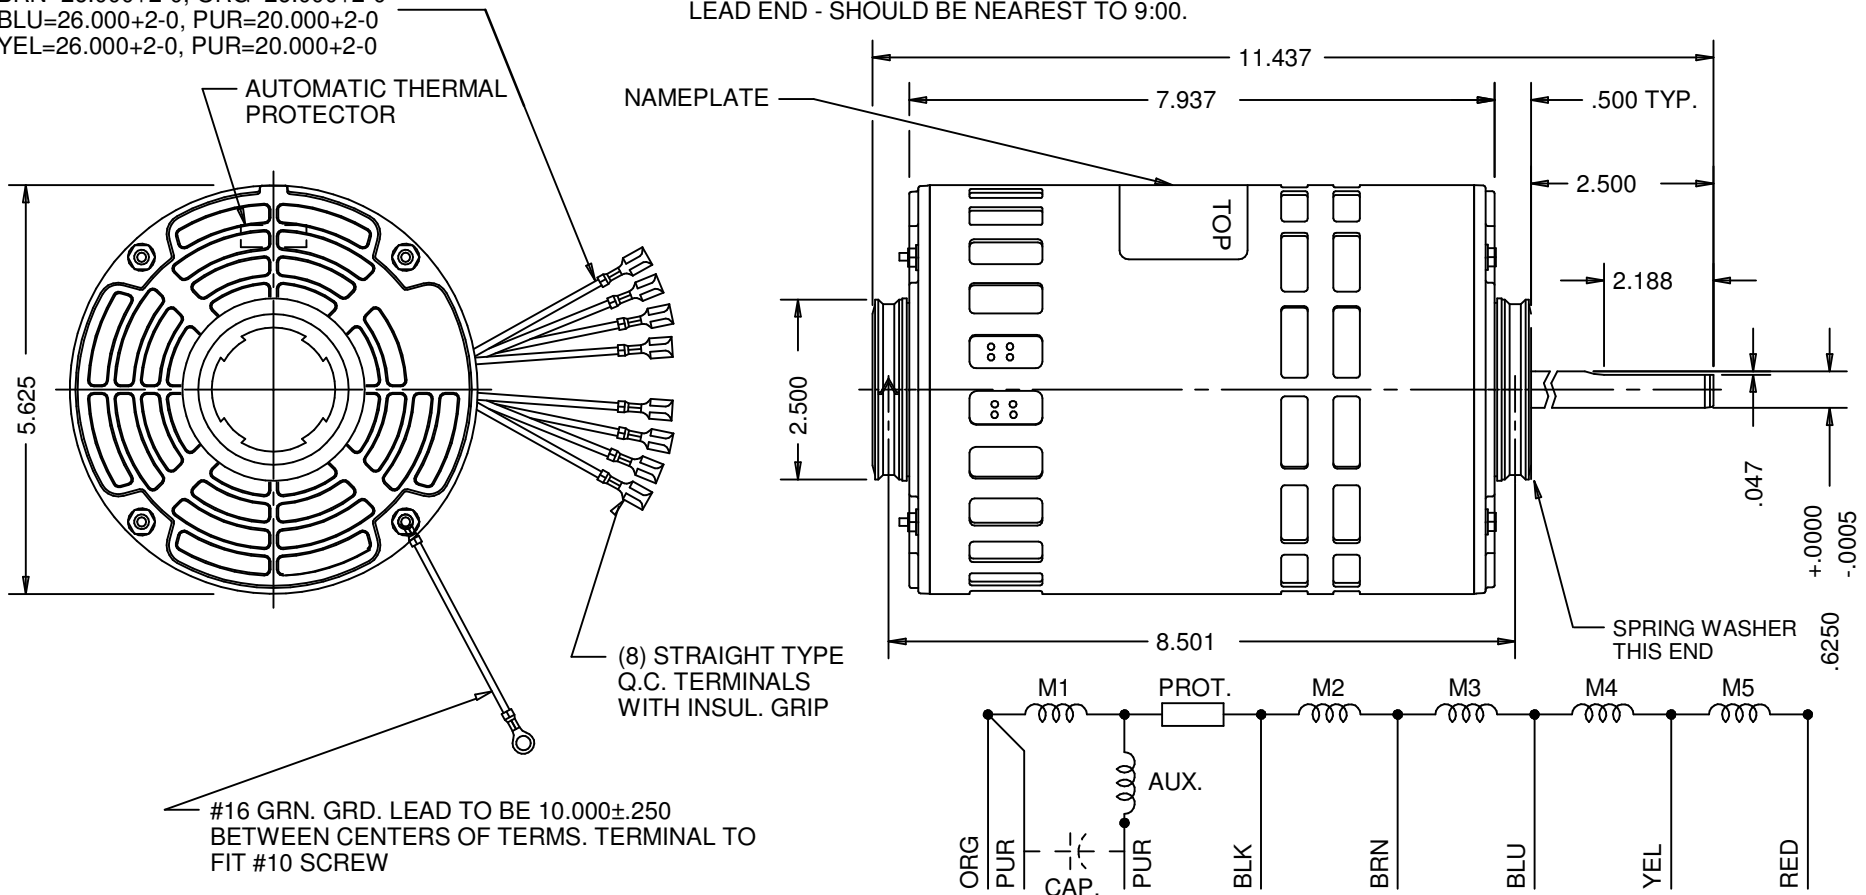

#16 GRN. GRD. LEAD TO BE 10.000±.250 BETWEEN CENTERS OF TERMS. TERMINAL TO FIT #10 SCREW

CLASS "B" INSULATION

BALL BEARING

NIDEC MOTOR CORPORATION 21-May-13

MODEL	REF	CUSTOMER	HP	VOLTS	AMPS	HZ	RPM	ROTATION	CUSTOMER PN	
K55HXTPB-9658		WHOLESALE-HAC	3/4	208-230	5.0	60	1075/5SPD	C. CW. LEAD END	CAT 8065	
REVISION RECORD FOR: JC 68407				INFORMATION DISCLOSED ON THIS DOCUMENT IS CONSIDERED PROPRIETARY AND SHALL NOT BE REPRODUCED OR DISCLOSED WITHOUT WRITTEN CONSENT OF NIDEC MOTOR CORPORATION				<b>NIDEC MOTOR CORPORATION</b>		
SHEET NUMBER	REV	CREATED DRAWING								
1 OF 1	--									
REVISION DATE				ALL DIMENSIONS ARE FOR REFERENCE ONLY UNLESS TOLERANCE IS GIVEN						
21-MAY-13				TITLE			CODE	ITEM NO.	SIZE	
ISSUED BY		REVIEWED BY	ENGINEER APPROVED	ASSEMBLED VIEW			V01	797237	A	
J. CASTILLO		B. GAITAN	B. GAITAN							